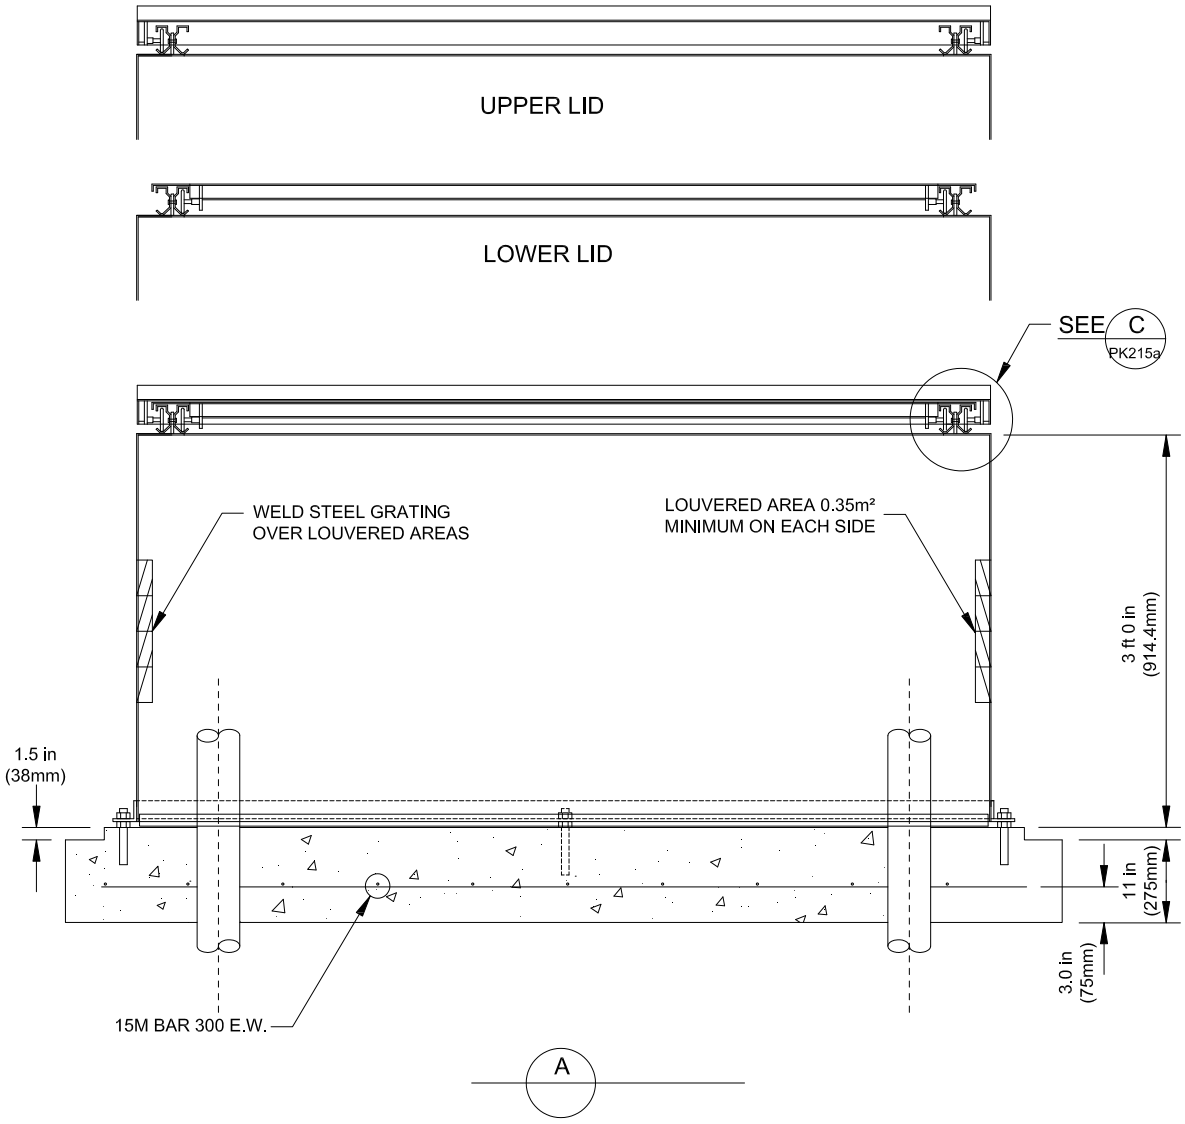

NOTES

1.) DIFFERENT COLOURED CONTROL WIRES (5) - 14 AWG WIRES BETWEEN THE FLOW METER AND THE CONTROLLER ENCLOSURE
2.) ORIENTATION OF BOOSTER PUMP STATION TO BE CONFIRMED WITH THE ENGINEER.
3.) DOOR AND WALLS TO BE 10 GAUGE STEEL PLATE.
4.) INSTALL GROUND ROD AND WIRE AS PER SPECIFICATIONS.
5.) ALL WELDS TO BE CONTINUOUS AND GROUND SMOOTH. PAINT ENCLOSURE AND PEDESTAL WITH 2 COATS.
6.) STEEL MESH IS TO BE WELDED TO THE BOTTOM OF THE CABINET TO PREVENT DEBRIS AND CRITTERS FROM ENTERING CABINET.
7.) ASA 61 GREY URETHANE ALKYO GLASS PAIN, INSIDE AND OUTSIDE SURFACES.
8.) MANUFACTURERS NAME TO BE WELDED/BRAZED ON OUTSIDE OF WALL.

No	YY MM DD DATE	REVISION DESCRIPTION	BY

DATE: June 6, 2016
SCALE: N.T.S.
DRAWN: A.B.
APPROVED: M.M.

PARKS & RECREATION
Medicine Hat
The Gas City

TITLE:
BOOSTER PUMP STATION SECTION

DWG No.: **PK214a** Rev.: